

Orange and Rockland Utilities, Inc.

# Request for Proposal (“RFP”)

---

Mountain Lodge Park Non-Wires Alternatives Program to Provide  
Solutions for  
Distribution System Reliability and Load Relief

---

ISSUED: 12/6/2019

SUBMISSION DEADLINE: 02/14/2020



**Orange & Rockland**



# Table of Contents

## Contents

- 1. Introduction..... 4**
  - 1.1. Background.....4
  - 1.2. Definitions .....4
  - 1.3. Purpose .....4
  - 1.4. General Guidelines .....5
  - 1.5. Non-Wires Alternatives High Level Process .....6
- 2. Mountain Lodge Park Non-Wires Alternatives Project Description ..... 7**
  - 2.1. Project Description.....7
  - 2.2. Project Need .....8
  - 2.3. Traditional Solution.....10
  - 2.4. NWA Solution Expectation.....10
- 3. Proposed Solution Requirements .....11**
  - 3.1. Professional Background and Experience with the Proposed Solution.....11
  - 3.2. Proposed Solution Description.....12
  - 3.3. Project Proposal Requirements.....12
  - 3.4. Functional Requirements.....14
  - 3.5. Detailed Project Plan and Timeline to Implement Solution .....14
  - 3.6. Detailed Costs Associated with Proposed Solution .....15
  - 3.7. Proposed Energy Storage Solutions.....16
- 4. Proposal Evaluation Approach.....17**
  - 4.1. Evaluation Criteria.....17
  - 4.2. Proposal Response and Submittal Instructions .....18
    - 4.2.1. RFP Schedule .....20
  - 4.3. Proposal Response Format .....20
    - 4.3.1. Cover Letter and Checklist .....21
    - 4.3.2. Respondent Checklist .....21
    - 4.3.3. Table of Contents .....21
    - 4.3.4. Professional Background and Experience with the Proposed Solution .....22
    - 4.3.5. Proposed Solution and Project Plan.....22
    - 4.3.6. Costs Associated with the Proposed Solution .....22
    - 4.3.7. Assumptions and Exceptions.....22
    - 4.3.8. Glossary of Terms .....22
    - 4.3.9. Non-Wires Alternative Solution Questionnaire .....22
- 5. RFP Terms and Conditions .....22**



<b>5.1.</b>	<b>Qualifications of Respondents .....</b>	<b>23</b>
<b>5.2.</b>	<b>Proprietary Information .....</b>	<b>23</b>
<b>5.3.</b>	<b>Cost of Proposal Preparation .....</b>	<b>23</b>
<b>5.4.</b>	<b>Right to Reject .....</b>	<b>24</b>
<b>5.5.</b>	<b>Revision to the RFP .....</b>	<b>24</b>
<b>5.6.</b>	<b>Basis of Contract Award .....</b>	<b>25</b>
<b>5.7.</b>	<b>Duration of the Contract.....</b>	<b>25</b>
<b>5.8.</b>	<b>Underperformance.....</b>	<b>25</b>
<b>5.9.</b>	<b>Security.....</b>	<b>25</b>
<b>5.10.</b>	<b>Subcontracting and Assignment .....</b>	<b>25</b>



# 1. Introduction

Orange and Rockland Utilities, Inc. (“O&R” or the “Company”) requests proposals from qualified and experienced respondents (“Respondent”) with the capability to deliver innovative non-wires alternatives (“NWA”) solutions that provide system reliability and load relief to the Company’s electric distribution system in Mountain Lodge Park, Town of Blooming Grove, New York.

## 1.1. Background

O&R is a subsidiary of Consolidated Edison, Inc., one of the nation's largest investor-owned energy companies, and an affiliate of Consolidated Edison Company of New York, Inc. (“Con Edison”). O&R, which provides electric and gas service to Orange County, Rockland County, and parts of Sullivan County, New York, is regulated by the New York Public Service Commission (“NYPSC” or “the Commission”).

O&R will use this NWA program to support the NYPSC’s regulatory Reforming the Energy Vision (“REV”) initiative. REV aims to reorient both the electric industry and the ratemaking paradigm toward a consumer-centered approach that harnesses technology and markets.

## 1.2. Definitions

**Benefit-Cost Analysis (“BCA”):** A BCA will be applied to potential NWA solutions. O&R developed a BCA Handbook in collaboration with the New York Joint Utilities<sup>1</sup> to provide consistent and transparent statewide methodologies that calculate the benefits and costs of potential projects and investments. The BCA Handbook can be found as Appendix E of [Orange and Rockland's Distributed System Implementation Plan](#), filed July 31, 2018 with the NYPSC.

**Distributed Energy Resource (“DER”):** Energy efficiency, demand response, solar, energy storage or other local distributed generation resources that prove to be feasible for the identified area of need.

**Non-Wires Alternative (“NWA”):** A solution proposed in an identified area as an alternative to a traditional infrastructure resolution for a distribution or transmission constraint. NWAs may be a single or portfolio of multiple DERs.

**Respondent:** A person and/or entity, or a representative thereof, replying to this RFP.

## 1.3. Purpose

This RFP solicits responses from Respondents that express an interest and have qualifications to supply O&R with solutions for distribution system load relief for the NWA program described below. To assist Respondents, this RFP provides information on the specific NWA program and provides requirements that Respondents must comply with when submitting their proposals.

---

<sup>1</sup> The New York Joint Utilities are comprised of O&R, Central Hudson Gas & Electric Corporation, Consolidated Edison Company of New York, Inc., New York State Electric & Gas Corporation, Niagara Mohawk Power Corporation d/b/a National Grid, and Rochester Gas and Electric Corporation.



This RFP is open to all DER approaches, or combinations of approaches, that display the potential to provide system reliability and load relief in the area identified. Proposed solutions must meet the need, or a portion of the need while maintaining system reliability at the lowest reasonable cost possible. O&R may seek to build a portfolio of projects that will diversify project execution risks and maximize benefits to customers.

In addition to the requirements specified in Section 4, each RFP response should, at a minimum, outline a Respondent's proposed approach, load relief impact, cost for completing the project, project plan or proposal, and a timeline for implementation. Responses must also include an hourly impact analysis resulting from the proposed DER solution, as well as a fully completed NWA Solution Questionnaire (Attachment A). The Company will not consider responses without the completed NWA Solution Questionnaire.

Respondents are expected to be financially and technically capable of developing, constructing, maintaining and operating their proposed projects such that the anticipated benefits can be realized. O&R will evaluate each Respondent's proposed solution against the solutions proposed by other Respondents. If O&R enters into a contract with a Respondent, the Respondent will be subject to defined milestones so that O&R can verify that the Respondent is on track to provide the contracted load relief. With regard to any contract entered into with a Respondent to implement a solution, such contract will provide that O&R may terminate that contract if O&R deems that load relief goals are not likely to be achieved.

#### **1.4. General Guidelines**

O&R reserves the right to make changes to this RFP by issuance of an addendum or amendments and to distribute additional clarifying or supporting information relating thereto. O&R may ask any or all Respondents to elaborate or clarify specific points or portions of their submission. Clarification may take the form of written responses to questions or phone calls or in-person meetings for the purpose of discussing the RFP and/or the responses thereto.

It is the sole responsibility of each Respondent to include all pertinent and required information in its submission. O&R reserves the right to determine in its sole discretion whether a submission is incomplete or non-responsive.

Respondents should clearly state all assumptions they make about the meaning or accuracy of information contained in their response to this RFP. If a Respondent does not ask questions or identify its assumptions, O&R will assume that the Respondent agrees with and understands the requirements in this RFP. While O&R has endeavored to provide accurate information to Respondents, O&R makes no warranty or representation regarding the accuracy of the information contained in this RFP.

Respondents are encouraged to provide and release necessary authorizations for O&R to verify any of such respondent's previous work, except where it is contractually prohibited from doing so.

The respondent shall be responsible for identifying, obtaining and complying with all local code requirements and obtaining all permits required for the construction and operation of the proposed DER solution. Areas for relevant permits include, but are not limited to, civil, structural, environmental and safety.

For stand-alone DG solutions including energy storage, the respondent must submit a Memorandum of Understanding ("MOU") or a letter of commitment from the land owner for any piece of property that the



respondent plans to leverage in order to install their proposed DER assets. Any proposal without this MOU or letter of commitment will not be considered for this project.

The respondent should also provide a high-level site layout plan that will incorporate all local Authorities Having Jurisdiction (“AHJ”) rules and regulations for siting any proposed DER assets. This RFP shall not be construed to establish an obligation on the part of O&R to enter into any contract, or to serve as a basis for any claim whatsoever for reimbursement of costs for efforts expended by Respondents.

Furthermore, O&R may revise the scope of this RFP at any time, or may withdraw or cancel this RFP at any time. O&R shall not be obligated or bound by any responses or by any statements or representations, whether oral or written, that may be made by the Company or its employees, principals or agents in connection with this RFP.

Any exceptions to the terms, conditions, provisions and requirements herein must be specifically noted and explained by a Respondent in its response to this RFP. O&R will assume that any response to this RFP expressly accepts all of this RFP’s terms, conditions, provisions and requirements, except as expressly and specifically stated otherwise by a Respondent in its response to this RFP.

### 1.5 NWA High Level Process

The process shown below in Figure 1 is an example of the high-level steps that occur during the identification of NWA solutions, as well as the evaluation, implementation, and verification of the identified solutions. There are multiple actions that take place between each step to move NWA projects forward to implementation and verification of load relief achieved.

The Company identifies potential NWA projects as part of its annual capital planning process. Traditional infrastructure projects are screened via the NWA suitability criteria based on project type (reliability, load relief or both), timeline and cost to gauge their suitability as NWA candidates. These alternatives may include DERs such as Energy Efficiency (“EE”), Demand Response (“DR”), clean (i.e., gas fired and solar) Distributed Generation (“DG”), and Energy Storage (“ES”), which may allow the Company to delay the construction of needed infrastructure.

The Company will leverage its existing EE and DR programs to lower the amount of DER that needs to be procured. The Company may entertain proposed EE and DR solutions that have the potential to enhance its existing programs.

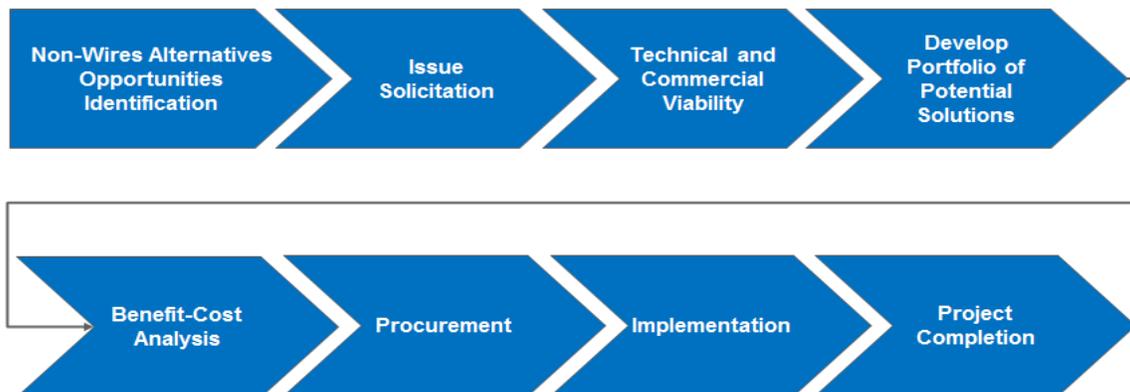


Figure 1: NWA Process Flow



## 2. Mountain Lodge Park NWA Program Description

### 2.1. Project Description

Mountain Lodge Park is a community of approximately 792 customers (Table 1), primarily residential, located off Clove Road in the Town of Blooming Grove, NY. Two pole mounted 1500 kVA (3-500 kVA transformers), 13.2 kV wye to 4.8 kV delta step down transformer banks feed the 4.8 kV distribution system in Mountain Lodge Park (Figure 2). One step down transformer bank (25/53) is located at the intersection of Clove Road and Mountain Lodge Road and serves 236 customers. The second step down transformer bank (10/87) is located at Clove Road and Glenwood Road serving 556 customers. In the event of a contingency on one of the step down transformer banks, a distribution tie between the two banks can be closed allowing the unaffected step down transformer bank to pick up all customers in Mountain Lodge. However, during peak load times the energized bank can only pick up 82% of the load. The goal of this NWA is to reduce the load in the Mountain Lodge Park area by 350 kW which will allow one step down transformer bank to carry the entire load and provide 100% backup in the event of a contingency. Load can be reduced at one or both of the step down transformer banks to meet the goal, however, the load reduction should be balanced among all three phases of the distribution system.


Step Bank	Customers*		
	Residential	C & I	Total
10/87	548	8	556
25/53	229	7	236
<b>Total</b>	<b>777</b>	<b>15</b>	<b>792</b>

\* As of [11/1/2019].

Table 1: Customer Breakdown



## Mountain Lodge Park Blooming Grove, New York

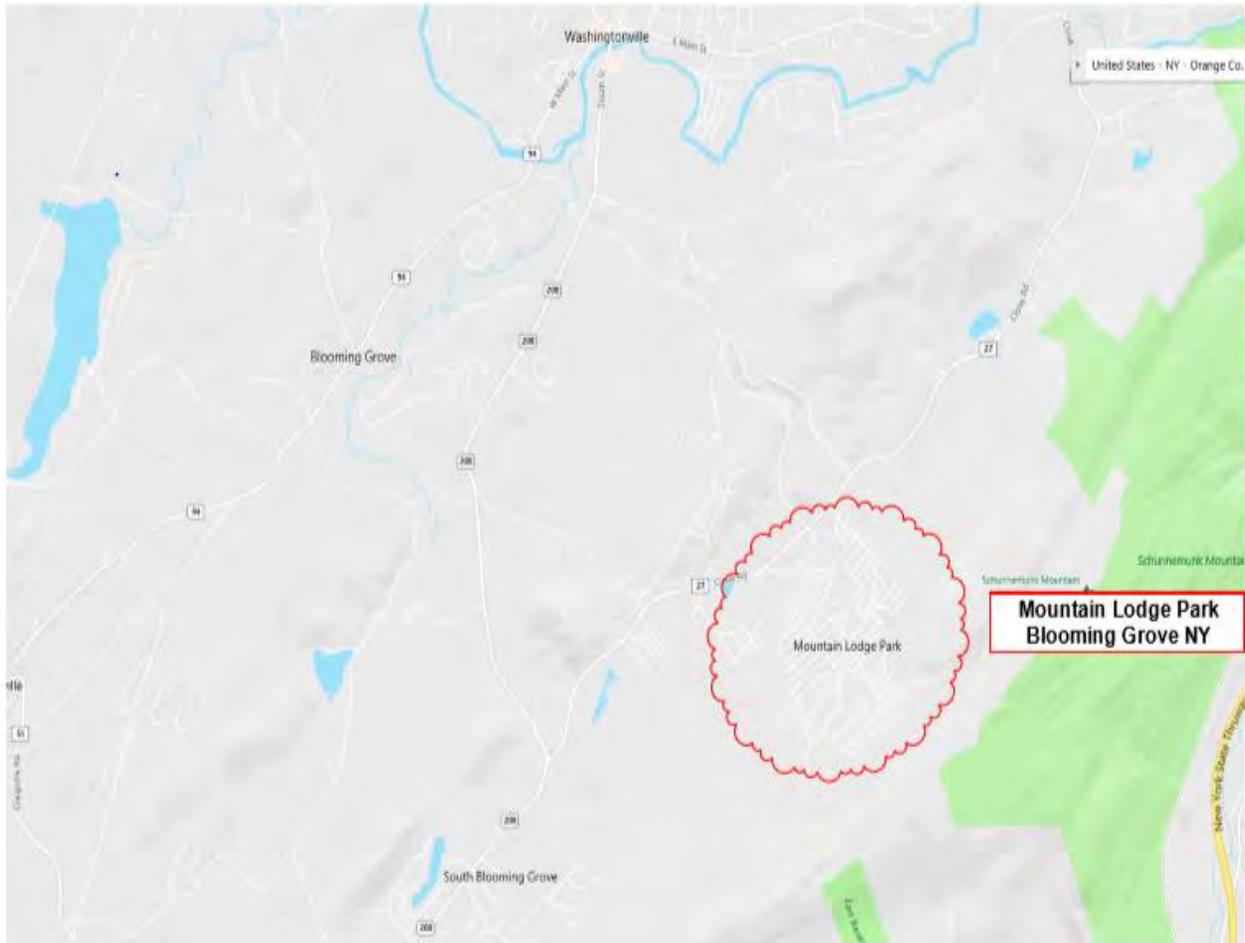

**Figure 2. Mountain Lodge Park Area.**

### **2.2. Project Need**

Figure 3 below illustrates the load profile for the Mountain Lodge Park area on a peak load day. In order not to exceed the allowable load on one of the step down transformer banks if the other step down transformer bank was to fail, load reductions would need to take place from 3:00 pm to 10:00 pm with a maximum load reduction of 350 KW taking place between 6:00 pm and 7:00 pm. For a typical summer period (June through September) it can be expected that the system load would reach levels requiring load reductions in the event of a contingency on either step down transformer bank 10/87 or 25/53 an average of 12 times annually.

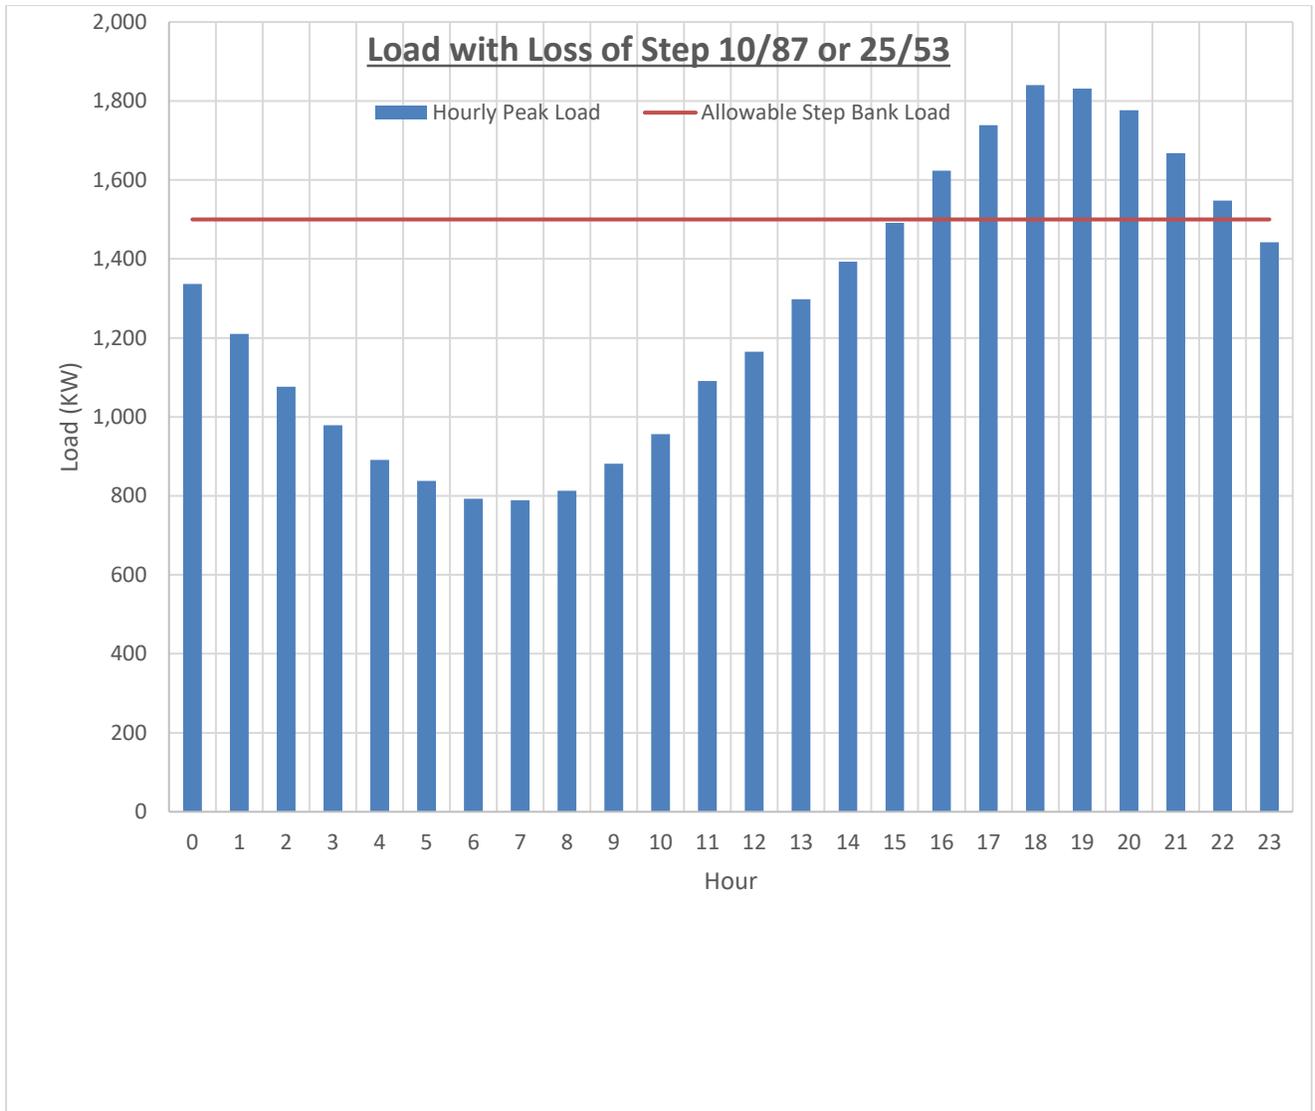


Figure 3: Mountain Lodge Peak Load Profile



### **2.3. Traditional Solution**

O&R's traditional solution to mitigate the loss of either step down transformer bank 10/87 or 25/53 is to convert the 4.8 kV distribution facilities to 13.2 kV operating voltage. This will eliminate the need for the two step down transformer banks altogether. In order to implement this conversion, significant tree clearing will be required in order to provide for the larger clearances as required by 13.2 KV facilities. Most of the existing utility poles and wires will also need to be replaced along with all the distribution pole mounted transformers. A three - phase 13.2 KV loop from Mountain Lodge Road to Glenwood Road to Clove Road would be established and the single-phase spurs along that rout would also be converted to 13.2 KV.

### **2.4. NWA Solution Expectation**

Prospective proposals for the NWA Program must meet the capacity requirements detailed in the provided peak load curve mentioned earlier. The complete solution may be an individual project or portfolio of DER. Proposed DERs must be able to provide the needed load relief at the times specified above via scheduled operations and/or as dispatched by O&R. The solution shall adhere to all other appropriate and reliable operating requirements and standards, including appropriate system protection for the distribution system and feeders, as applicable.

For proposed in-front of the meter DG solutions, proposals should be site-specific with a detailed description of the technology, operation and maintenance needed to maintain the safety needed to serve our customers. Respondents should consider the 4,800-volt delta distribution system and the interconnection challenges it presents when proposing such solutions. The proposal should include control systems that are capable of remote monitoring and control and that can be integrated into O&R's existing Distribution Supervisory Control and Data Acquisition ("DSCADA") system. Any protection schemes proposed for any DER technologies, must be capable of distinguishing internal from external system disturbances to prevent nuisance tripping to support the resiliency of the O&R system.

O&R currently has energy efficiency and demand response programs that may be used to reduce the load in Mountain Lodge Park. The Company encourages proposals from all DER technologies, including EE, DR and behind the meter DG including storage, that could contribute to the portfolio solution that may be used to augment and supplement existing programs to provide further load reductions based on the need and the demographics of the area.



### 3. Proposed Solution Requirements

This section outlines the requirements for responses to the RFP. Respondents should submit their responses to the functional questions included in Attachment A, as part of their proposals. Respondents are encouraged to include, as an attachment (maximum size – 2 MB), any additional information that will clarify how their proposed solution(s) will achieve the required demand reduction. Review priority will be given to the information submitted within the provided format.

#### 3.1. Professional Background and Experience with the Proposed Solution

Respondents must be able to demonstrate experience deploying the proposed solution. In addition, Respondents should provide the following:

- Executive Summary of proposal;
- Description of Respondent’s core business and organizational structure;
- Project organizational chart and project team resumes;
- Financial statements for the past three years, and services offered;
- Examples of prior industry specific work that is similar in nature and relevant to the NWA solution requirements, with particular emphasis on implementation of the solution, such as at other utilities, large municipalities, co-ops, or any other applicable facilities;
- Relevant project experience;
- Contact information of customers where the solutions have been implemented (at least three references);
- Letters of support from customers who plan to implement the solution at their site in the applicable area of need identified (**Note:** O&R will need to verify customer qualifications);
- References which shall include any authorizations necessary for O&R to verify;
- Specific location of successful technology deployment;
- MOU or Letter of Agreement from the landowner of the proposed location to deploy DER assets; and
- Any other relevant information deemed appropriate and noteworthy supporting and validating the proposed solution.

Respondents should address any estimated costs associated with implementing the proposed technology/solution, including customer and utility costs, as well as any other relevant costs. Respondents should also describe in detail non-energy benefits associated with the proposed solutions such as net avoided carbon, SO<sub>x</sub>, NO<sub>x</sub> per \$/ton.



Respondents should identify and provide contact information for customers who have implemented the technology/solutions. Respondents should note whether O&R could contact these customers for additional information and follow-up questions.

### **3.2. Proposed Solution Description**

Proposals must satisfy meeting the capacity requirements detailed in the provided 24-hour peak day load curves. The complete solution may be comprised of a portfolio of DER technologies.

Project proposals must demonstrate how the proposed solution will achieve or contribute to the demand reductions sought and maximize value to O&R's customers. Detailed project information should include:

- Technology/Solution description (tested and proven or innovative technology);
- Portion of the needed load reduction that is expected to be met as part of a portfolio (if less than 100%)
- Type of contract (e.g., shared savings, performance contract, sale (Utility to Own), lease-purchase, power purchase agreement);
- Performance characteristics of the technology;
- Description of the flexibility and applicability of the technology;
- Hourly electric load reduction impact provided by the solution;
- Community and environmental impacts derived from the solution;
- Potential risks and challenges of deploying the particular DER asset being proposed;
- Proposal for mitigating risks and challenges of deploying the DER asset;
- Specification and details associated with implementing the proposed solution (e.g., permitting requirements);
- Proposed site-layout and one line of the proposed project, taking into account all local AHJ rules and regulations;
- Detailed description of non-energy benefits associated with the proposed solution; and
- Ability to increase or decrease the scale of the proposed solution.

The proposal must specify the data (e.g., detailed calculations) and methodology used to determine the estimated demand reduction and annual kWh savings attributable to each DER measure proposed to be installed.

### **3.3. Project Proposal Requirements**

Respondents are encouraged to submit alternative, creative proposals for marketing, sales, financing, implementation, and maintenance, or transaction structures and pricing formulas that will achieve the demand reductions sought while maximizing value to O&R's customers.



Selected Respondent or Respondents, if subsequently contracted with to provide their solutions, will be required to provide full facility and equipment access to the Company and its representatives for pre- and post-installation inspections to verify the installations and the demand reductions, and for subsequent inspections (which may be performed at the Company's discretion), to verify continued operation and maintenance of the DM measures for the applicable term.

The new DER measures must be in service, and the pledged demand reduction must be guaranteed to commence, by the respective need dates for the applicable load area, to address forecasted summer overloads. The type of compensation structure should be included (upfront payment/yearly payment, combination of 50% upfront pay, and 5% payment annually for a 10-year contract period, pay-for-performance, loan program or other).

Vendors must provide all methods and procedures required to comply with technical, safety and operational requirements for the interconnection and operation of their equipment with the Company's electric delivery system, as well as performance measurement and verification ("M&V") (i.e., are kW actually reduced). For any proposed renewable generation, it is particularly important to verify that any stated demand reduction coincides with the Company's peak loading period. The Company reserves the right to require periodic witness testing on any proposed protective systems and electric system interconnections that could adversely affect the Company's electric delivery system should they fail.

Financial assurances will be required so that the committed amount of demand reduction measures will be installed and the committed in-service date for each measure will be met. Failure to achieve the committed demand reductions or to meet the committed in-service dates will result in liquidated damages and/or other consequences which will be established during the contracting process.

The proposal should specify the data and methodology used to determine the estimated demand reduction, annual kWh savings attributable to each measure/solution proposed to be installed, and methods/proposals to confirm M&V of delivered demand reductions.

Respondents proposing to market the installation of demand management measures to others should include a full and complete assessment of the opportunities. At a minimum, this assessment should include a description of the markets, such as one-to-four family homes, multifamily buildings, small commercial (e.g., retail stores, restaurants), large commercial (e.g., office buildings, industrial) and government or institutional (e.g., hospitals, hotels, schools, colleges), and the applicable demand management measures and technologies to be directed at each selected market or customer segment. In addition, Respondents should illustrate the marketing and sales strategies that



they will employ to capture the selected market or customer segment and to deliver the demand reductions included in their proposals. Preference will be given to Respondents which have pre-existing customer agreements to deploy (previously and successfully deployed) the solution.

Of key importance to the review of any proposal is consideration of community impact. Proposals must provide information on elements of the proposal that affect the community (both positively and negatively) including, but not limited to, associated greenhouse gas (“GHG”) emissions, waste streams and management, job creation potential and community disruption.

The Company is interested in proposals that will take advantage of funding available from other funding streams (e.g., participation in NYISO markets or NYSERDA funding). Respondents should also identify their ability to execute the NWA program by providing reference to successful similar projects that they have completed in other jurisdictions. Respondents are to provide detailed explanations and validation of such funding strategies, including examples that are provable and repeatable.

### **3.4. Functional Requirements**

A detailed Non-Wires Alternatives Solution Questionnaire is included in Attachment A. Please provide your responses in the document and submit with your RFP proposal. Major categories within the Questionnaire include:

- Cost per MW;
- Respondent’s go-to-market strategy;
- M & V confidence plan;
- Other Funding Sources Available;
- Environmental and Community Impacts;
- Respondent’s Market Understanding;
- Proposed Solution Benefits;
- Other Funding Opportunities; and
- Other Additional Information to clarify or further explain the RFP proposal.

### **3.5. Detailed Project Plan and Timeline to Implement Solution**

Proposed DER measures must be in service, and the pledged demand reduction must be guaranteed to commence, by the date(s) specified in the NWA Program Description section above.

- Responses must contain a detailed plan to implement the solution including:
  - General scope of work;
  - Customer acquisition and marketing plan;



- Communications plan to reach out to local AHJs ;
  - Financing, including transaction structures and pricing formulas;
  - Implementation plan and project schedule;
  - Identifying risks and possible impact to the project timeline; and
  - Operation and Maintenance plan (if, applicable).
- Respondents proposing to market the installation of DER measures to customers should include a full and complete assessment of the DER opportunities. At a minimum, this assessment should include a description of the markets, such as one-to-four family homes, multifamily buildings, small commercial buildings (e.g., retail stores, restaurants), large commercial buildings (e.g., office buildings, industrial) and government or institutional buildings (e.g., hospitals, hotels, schools, colleges), and the applicable DER measures and technologies to be directed at each selected market or customer segment.
  - Respondents must illustrate the marketing and sales strategies that will be employed to capture the selected market or customer segment and to deliver the demand reductions included in their proposals. Preference will be given to Respondents with pre-existing customer agreements to deploy the solution upon confirmation by the Company. Marketing and sales plans must be expressly approved by the Company.
  - The response must contain a detailed M&V plan for verifying the solution’s load reduction. The plan must include provisions for access by the Company and/or its representatives for quality control and quality assurance. Independent M&V may be performed at the Company’s discretion. The Company’s M&V will include, but not be limited to, verification of continued operation and maintenance of the DER measures for the applicable term.
  - Proposals must provide information on elements of the proposal that affect the community (both positive and negative) including, but not limited to, associated GHG emissions, waste streams and management, job creation potential, and community disruption.
  - Proposals must outline a detailed timeline from project planning, contracting, to implementation and completion of the proposed solution.

### 3.6. Detailed Costs Associated with Proposed Solution

- Respondents must provide a detailed cost breakdown in the format shown below.

DER solution	Size	Material Cost	Labor Cost	Admin Cost	Total O&R cost	Total Cost of the Project

- Respondent should itemize and identify various items in each of the cost buckets, e.g., material cost



components, labor cost components.

- Respondents should identify other funding streams that may be used to mitigate cost impact to the Company's customers (e.g., City, State, and Federal funding opportunities). Respondents should also identify if private sector funding will be used.
- Please provide the cost structure for both up-front lump-sum payment, as well as annual payments over the 10-year contract term and payment structure where the Company will pay 50% of the incentive upfront while providing a 5% incentive annually for a 10-year contract period.
- Estimated interconnection costs will be provided based on proposed solutions or will be borne by O&R and included in the project BCA.

### **3.7. Proposed Energy Storage Solutions**

Respondents proposing energy storage solutions should provide the following information in addition to that required for all proposals:

- In addition to the cost breakdown in Section 3.6, respondents proposing energy storage solutions should provide the cost of the solution by \$/kw-month, \$/MWh, and \$/MW for the five-month availability period, as discussed in Section 2.2.
- Please propose costs for different ownership structures, mainly:
  - Utility-ownership: O&R owns the storage system but operation and maintenance is performed by the vendor in the short-term.
  - Leasing/Tolling: Vendor owns the storage system and O&R leases or is guaranteed capacity. Vendor performs O&M.
- Respondents should address their strategy for maintaining energy storage capacity for the duration of the asset lifetime and provide the cost for doing so, whether it be a higher up-front cost for overbuild or a maintenance cost for the life of the project. Other maintenance strategies will also be accepted.
- The Company is interested in proposals which will take advantage of funding available from other funding streams, e.g., participation in NYISO market to offset costs. Proposals should state the intention of seeking these types of additional funding and whether that funding would be used to reduce the cost of system or be split with the Company in a sharing arrangement.
- The Company is interested in projects that will go above and beyond the need of the NWA project to identify cost effective opportunities to reduce customers' total bill. This may include upsizing the energy storage beyond the need of the NWA, in order to participate in additional revenue streams that will further reduce the overall



cost of the project.

- Provide any end of life considerations and their costs, i.e., removing the equipment after the end of its lifecycle, repurposing the equipment, recycling and/or site remediation.

## 4. Proposal Evaluation Approach

Solutions proposed in response to this RFP will be reviewed in detail by O&R. O&R will use an evaluation framework to develop the optimal portfolio to address the identified need.

Respondents should also note that each measure of any proposal submitted, whether part of a single-measure proposal or a multiple-measure proposal, will be evaluated against other like measures for equal comparison. Thereafter, the Company may evaluate all measures in the aggregate in a manner that considers the overall benefit to the Company based on the criteria set forth in this RFP, and to include considerations that could allow for the selection of individual measures across multiple proposals.

### 4.1. Evaluation Criteria

O&R will review all solutions proposed in response to this RFP. Some of the main review criteria are listed below. The review process is designed to be fair and equitable, with the objective of identifying potential solutions that provide the greatest overall value to customers.

Evaluation criteria will include but not be limited to:

1. Proposal content – Information requested has been provided and is comprehensive to allow for evaluation;
2. Viability - the extent to which the Respondent's proposed solution provides the needed solution mentioned in this RFP;
3. Technology – DER maturity, ability to scale, challenges in deploying proposed DER, as depicted in section 3.5;
4. Functionality - the extent to which the proposed solution would provide needed load reductions and reliability requirements in the area, as depicted in sections 3.4 and 3.5;
5. Environmental and community impacts associated with the proposed solution;
6. Unit Cost – total cost, and \$/MW at peak required for the proposed solution; cost inclusivity as outlined in section 3.7;
7. BCA – a BCA of the proposed solution will be performed in accordance with O&R's BCA Handbook as filed with the NYPSC; a BCA will be applied to the portfolio of solutions to determine feasibility of implementing a NWA solution;
8. Timeliness - the ability to meet O&R's schedule and project deployment requirements;
9. Price and reliability, particularly as compared to other proposed solutions along with the dependability and benefits that would be provided to the grid;



10. Respondent Qualifications - the Respondent's relevant experience and success providing these solutions to other locations, including reference checks and documented results;
11. Applicability to REV- the extent to which the proposed solutions support the goals and objectives outlined in the REV Proceeding;
12. Feasibility - the expected ease of project implementation within the timeframe required for the NWA solution (e.g., permitting, construction risks, operating risks); siting, customer acquisition and interconnection challenges;
13. Community impact - the positive or negative impact that the proposed solution may have on the community in the identified area (e.g., noise, pollution).
14. Brief Communications Summary: At O&R, communication and maintaining positive working relationships with the municipalities and the communities we serve is essential. Therefore, it is imperative that potential vendors and contractors when approaching a municipality bear this in mind. Please provide a brief communication summary that demonstrates experience with stakeholder and community engagement methods.

## 4.2. Proposal Response and Submittal Instructions

Respondents are strongly encouraged to submit a proposal in accordance with the summary instructions outlined in this section, with the proposal also to focus on the requirements of the [Non-Wires Alternative Solutions Requirements](#) section as well as a required submittal of a fully completed **Non-Wires Alternatives Solution Questionnaire (Attachment A)** as a separate attachment, and such other requirements set forth in this RFP. Respondents are required to submit their bid response through the Company's Procurement System ("Oracle RFQ System"). Any limitation regarding Respondent's ability to supply information requested in this RFP (or to support or perform a particular function or service) should be explicitly stated in the proposal response. Any partnering with other solution providers to perform a particular function or service must be explicitly stated.

All proposals must be submitted through the Oracle RFQ System on or prior to the due date and time. Respondents who fail to submit by the due date and time will be locked out of the Oracle RFQ System and unable to submit their proposals. Therefore, Respondents are encouraged to upload their proposals well in advance of the closing time to avoid any potential issues that may occur, including due to unfamiliarity with the Oracle RFQ System, or otherwise. Respondents must take the following actions to complete their proposal submission:

1. Download this Non-Wires Alternative RFP, Non-Wires Alternative Questionnaire (Attachment A), and Supplier Enablement Template.
2. Become enabled in the Oracle RFQ System by submitting the below items to Michael Heaton at [heatonm@coned.com](mailto:heatonm@coned.com) (note that if Respondent has previously been enabled in the Oracle RFQ System as part of a separate bid event then they do not have to do it again, but should email Mike Heaton to notify him of participation interest for this RFP):



- a. W-9 form (version last updated); and
  - b. Supplier Enablement Template (Select 'Sourcing' under Oracle responsibility field).
3. Receive Formal RFQ response request (will be same information downloaded from NWA website).
  4. Submit response and fully completed questionnaire to Oracle RFQ System.

**Responses delivered by hand or fax, regular mail, or any other method will not be accepted.** O&R will not be responsible for late, lost, illegible or misdirected submissions.

Review of responses submitted to this RFP will be coordinated through the O&R Utility of the Future organization and other Company departments as necessary. O&R, at its option, may contact Respondents with additional questions or information requests. Additional action by O&R related to this RFP is solely at the Company's option. As such, the Company has no obligation to address questions, comments, or information requests related to this RFP after receipt of Respondents responses.

#### **Contact Information and Questions**

All Respondents should direct questions during the clarification question timeframe via email to Michael Heaton, [heatonm@coned.com](mailto:heatonm@coned.com), of O&R's/Con Edison's Supply Chain Department. All questions and answers deemed essential for the viable submission of a bid response will be publicly posted at [www.oru.com/nonwires](http://www.oru.com/nonwires)

Respondent's identities will be kept confidential.

The Company will have no obligation to evaluate late submissions, nor be responsible in any way for any consequences associated with late submissions.



### 4.2.1. RFP Schedule

Below is the expected schedule to be followed for this solicitation:

RFP Solicitation Milestones	Completion Date*
RFP Issued	<b>December 6, 2019</b>
Pre-bid conference call (see details below)	<b>December 12, 2019</b>
Deadline to submit clarification questions	<b>December 27, 2019</b>
Responses to clarification questions due	<b>January 15, 2020</b>
Deadline to become enabled in O&R/Con Edison procurement system	<b>January 15, 2020</b>
Qualified respondents' proposals due	<b>February 14, 2020</b>

\*O&R reserves the right to change any of the above dates.

Pre-bid conference call details:

Date: 12/12/2019

Time: 2:00 – 3:00 PM

[Join by phone](#)

Dial-in Number: **(646) 679-1825**

Meeting ID: **775773783**

Smartphone link:  [\(646\) 679-1825,, 775773783#](tel:(646)679-1825)

[Join by web browser](#)

[Follow this link](#) for video conference and screen sharing.

Can't join the meeting? [Contact support.](#)

### 4.3. Proposal Response Format

**Note:** The Oracle RFQ System is only capable of accepting individual documents no larger than 5 MB in size. Respondents may find it necessary to divide large documents into smaller files due to this system constraint. The



written proposal response for the NWA solution should be organized as follows:

Proposal Section	Proposal Section Title
N/A	Cover Letter
N/A	Respondent Checklist (Appendix)
N/A	Table of Contents
1	Professional Background, Financials and Experience with the Proposed Solution (as described in section 3)
2	Proposed Solution Response & Project Plan (as described in Section 3)
3	Cost Associated with Proposed Solution ( as described in Section 3)
4	Assumptions and Expectations
Appendix	Glossary of Terms
Attachment	Non-Wires Alternatives Solutions Questionnaire Response

### 4.3.1. Cover Letter and Checklist

The Respondent’s cover letter shall include the following:

- The legal name and address of Respondent;
- The name, title and telephone number of the individual authorized to submit information and execute the Agreement on behalf of Respondent;
- The signature of a person authorized to contractually bind Respondent’s organization; and
- Statement that the Respondent has read, understands, and agrees to all provisions of the RFP or alternatively, indicating that exceptions will be taken to the RFP and identifying such exceptions.

### 4.3.2. Respondent Checklist

Respondent checklist: Respondent should provide to the Company the properly completed Respondent Checklist (Appendix) as part of the proposal.

### 4.3.3. Table of Contents



Include a clear identification of the proposal by section and by page number as identified above.

#### **4.3.4. Professional Background and Experience with the Proposed Solution**

This section is for the Respondent to provide an executive overview and summary of your company and general description of the key features of Respondent's proposed solution. It should include the items outlined in Section 2.1 of the RFP. Respondent shall also identify all subcontractors that it will employ to complete the proposed solution.

#### **4.3.5. Proposed Solution and Project Plan**

This is a response to the solution requirements as outlined in this document. Respondents should also provide a proposed project plan for the solution.

#### **4.3.6. Costs Associated with the Proposed Solution**

Respondents should provide a detailed breakdown of the costs associated with implementing the proposed solution.

#### **4.3.7. Assumptions and Exceptions**

Respondent should provide a list of assumptions made in developing the response to this RFP that should be considered when evaluating the response. Respondent should provide a stand-alone section listing any exceptions to the RFP (i.e., indicate which deliverables of the RFP Respondent cannot meet).

#### **4.3.8. Glossary of Terms**

Respondent should provide a glossary of terms that is specific to the Respondent's solution.

#### **4.3.9. Non-Wires Alternative Solution Questionnaire**

Respondents should attach the responses to the **Non-Wires Alternative Solution Questionnaire (Attachment A)**, including as much detail possible, with the RFP submittal.

## **5. RFP Terms and Conditions**

Each Respondent is solely responsible for including all pertinent and required information in its submission. O&R



reserves the right to determine, at its sole discretion, whether a submission is incomplete or non-responsive.

Respondents should state clearly all assumptions made with respect to this RFP. In the absence of an explicit statement to the contrary, each Respondent shall be deemed to have agreed with and understood the requirements of this RFP. While O&R has endeavored to provide accurate information, O&R makes no warranty or representation of accuracy.

Any exceptions to the terms, conditions, provisions, and requirements herein must be specifically noted and explained in Respondent's response to this RFP. O&R will assume that any response to this RFP expressly accepts all the RFP terms, conditions, provisions and requirements, except as expressly and specifically stated in Respondent's response to this RFP.

Respondents agree to keep confidential all information provided by O&R in connection with this RFP.

### **5.1. Qualifications of Respondents**

The Company may make such investigation as the Company deems necessary to determine the qualifications of Respondent and proposed subcontractors to perform the work. A Respondent should promptly furnish any information and data for this purpose as may be requested by the Company. The failure of a Respondent to produce timely information and data requested by the Company may provide a basis for rejection of the proposal.

### **5.2. Proprietary Information**

If a proposal includes any proprietary data or information that a Respondent does not want disclosed to the public, Respondent must specifically designate such data or information on each page on which it is found. O&R shall be held harmless from any claim arising from the release of proprietary information not clearly identified as such by a Respondent. Because of the need for public accountability, the following information regarding the proposal shall not be considered proprietary, even if such information is designated as such: pricing terms and non-financial information concerning compliance with RFP specifications.

### **5.3. Cost of Proposal Preparation**

The cost of preparing a proposal in response to this RFP, including, but not limited to, the cost associated with site visits and preliminary engineering analysis, is solely Respondent's responsibility and will not be reimbursed by O&R.



#### **5.4. Right to Reject**

This RFP shall not be construed to establish an obligation on the part of O&R to enter into any contract, or to serve as a basis for any claim whatsoever for reimbursement of costs for efforts expended by Respondent. Furthermore, the scope of this RFP may be revised at the option of O&R at any time, or this RFP may be withdrawn or cancelled by O&R at any time. O&R shall not be obligated by any statements or representations, whether oral or written, that may be made by the Company, its employees, principals, or agents in connection with this RFP.

O&R reserves the right to accept any responsive proposal, to reject any and all proposals, and to waive irregularities or formalities if deemed to be in the best interests of the Company. Any such waiver shall not modify any remaining RFP requirements nor excuse any Respondent from full compliance with all other RFP specifications and contract requirements if the Respondent is awarded the contract. O&R shall reject the proposal of any Respondent that the Company determines not to be a responsible bidder, or whose proposal the Company determines to be non-responsive.

O&R reserves the right to withdraw this RFP at any time and for any reason, and to issue such clarifications, modifications, and/or amendments as it may deem appropriate. Receipt by the Company of a response to this RFP confers no rights upon a Respondent, nor any obligations upon the Company.

#### **5.5. Revision to the RFP**

O&R reserves the right to make changes to this RFP by issuance of one or more addenda or amendments and to distribute additional clarifying or supporting information relating thereto. O&R may ask any or all Respondents to elaborate or clarify specific points or portions of their submission. Clarification may take the form of written responses to questions or phone calls or in-person meetings for the purpose of discussing the RFP, the responses thereto, or both.

If it becomes necessary to clarify or revise this RFP, such clarification or addendum shall be issued by the Company by letter, email or written addendum to the RFP. Any RFP addendum shall be delivered by hand, certified mail, facsimile, e-mail or delivery by courier service which certifies delivery. Only those respondents that have already received the proposal documentation directly from the Company will be provided the clarification. Any addendum to, and/or clarification or revision of this RFP shall become part of this RFP and, if appropriate, part of the



Agreement that derives from the RFP.

## **5.6. Basis of Contract Award**

Any contract award(s) that may be made by the Company shall be made to the most responsive and responsible Respondent meeting the specifications, price and other factors considered, as determined by the Company, in its sole discretion. The proposal evaluation criteria are set forth within this RFP.

## **5.7. Duration of the Contract**

The duration of the Agreement will be for a term agreed to by O&R and the Respondent during contract negotiations and will depend on the parameters of the proposed solution(s) (e.g., the ability to defer traditional capital investments for as long as possible while meeting BCA criteria). Agreements will typically commence upon the completion of construction and commencement of operation of the solution unless otherwise provided herein. In the event that the Company determines not to proceed with the project, the successful Respondent will be paid in accordance with the amounts as agreed by the Respondent and the Company.

## **5.8. Underperformance**

Respondents should note that failure to deliver load relief committed to as part of any solution may result in liquidated damages and/or other consequences provided for by the contract between Respondent and O&R.

## **5.9. Security**

Respondents are put on notice that if a Respondent's solution is selected, then Respondent will be required to furnish security to O&R that demonstrates, among other things, financial capability to pay liquidated damages in the event that the Respondent fails to satisfy its Load Reduction Guaranty during the period required.

## **5.10. Subcontracting and Assignment**

No portion of the work associated with any project resulting from a successful response to this RFP by a Respondent may be delegated, subcontracted, assigned, or otherwise transferred without the prior written approval of the Company in each case.



**Appendix A: Respondent Checklist**

The Respondent must complete and provide the following checklist to the Company as part of the Respondent’s proposal.

Checklist Item	Initial
REVIEWED ALL RFP DOCUMENTS AND LAWS AND REGULATIONS THAT IN ANY MANNER MAY AFFECT COST, PROGRESS, OR PERFORMANCE	
FULLY COMPLETED PROPOSAL ADHERING TO THE FORMAT PROVIDED WITHIN THIS RFP	
ENABLED IN CON EDISON PROCUREMENT SYSTEM	
FULLY COMPLETED NON-WIRES ALTERNATIVE SOLUTION QUESTIONNAIRE (ATTACHMENT A)	
<ul style="list-style-type: none"> <li>• Summary</li> </ul>	
<ul style="list-style-type: none"> <li>• Energy</li> </ul>	
<ul style="list-style-type: none"> <li>• Financials</li> </ul>	
<ul style="list-style-type: none"> <li>• Additional Review Criteria</li> </ul>	

NOTE: FAILURE TO COMPLY WITH RFP PROCESS, COMPLETION AND SUBMITTAL OF ALL THE ABOVE DOCUMENTS ON THE FORMS PROVIDED HEREIN, WILL RESULT IN A REJECTION OF YOUR BID.

By placing my initials in the boxes provided above, I acknowledge having read and that I understand fully all of the requirements of this RFP, including with regard to each of the documents referenced herein.

RESPONDENT (SIGNATURE):

RESPONDENT (PRINT NAME):

DATE: